# CERTIFICATE

igris

# Material Fire Test Certificate

#### IGNL-7055-07-01C I01 R00

DATE OF TEST	17.04.2023
	24.05.2023
ISSUE DATE	18.08.2023
EXPIRY DATE	17.08.2028

AS/NZS 3837:1998 Method of test for heat and smoke release rates for materials and products using an oxygen consumption calorimeter

## SPONSOR

**3RT Technologies Pty Ltd** Suite 9 / 13 Corporate Drive Heatherton, VIC 3202

### TEST BODY

Ignis Labs Pty Ltd ABN 36 620 256 617 3 Cooper Place Queanbeyan NSW 2620 Australia www.ignislabs.com.au (02) 6111 2909 Test body is the test location



Specimen	Identification
3RT Black	outt

#### Specimen Description

The sponsor described the specimens as 3RT engineered hardwood. It is composed of engineered hardwood and is light brown in colour. Its end use is as cladding and panelling.

The received specimens were hardwood panels. They had a measured nominal thickness of approximately 20.79 mm and a measured nominal density of 1.02 g/cm<sup>3</sup>.

Ignis Labs was not responsible for the sampling stage. All specimens were sampled and fabricated by the test sponsor. The test results apply to the specimens as received.

#### Test Method

Three (3) specimens were tested in accordance with the requirements of AS/NZS 3837. Prior to the test, the specimens were conditioned at an ambient temperature of 23  $\pm 2$  °C and a relative humidity 50  $\pm 5$  %.

#### Observations

The specimens exhibited similar behaviour, and all ignited during the test. The specimens ignited between 31 and 45 seconds into the test and ignition continued for one hour at which point the testing was stopped. Approximately five minutes after ignition, the flame intensity began to fade. Significantly less smoke emission was observed from specimen 1 than the other specimens. The surface of the specimens expanded upwards after ignition.

After testing, the specimens were flaky and charred with white ash on the surface.

Input								
Test Heat Flux (kW/m <sup>2</sup> )	50.0							
		Sp 1	Sp 2	Sp 3	Sp 4	Sp 5	Sp 6	Mean
Thickness (mm)		20.67	20.87	20.67	-	-	-	20.74
Surface Area (m²)	As	0.00884	0.00884	0.00884	-	-	-	0.00884
Mass Before the Test (g)	mi	215.96	215.05	213.18	-	-	-	214.73
Mass After the Test (g)	mf	34.51	38.30	35.81	-	-	-	36.21
Time to Ignition (sec)	t <sub>ig</sub>	31	45	35	-	-	-	37.00
Test Start Time (sec)	t <sub>start</sub>	0	0	0	-	-	-	0.00
Calculation								
Density (kg/m³)	ρ	49.92	50	50	-	-	-	49.97
Irradiance (kW/m <sup>2</sup> )		0.024	0.024	0.024	-	-	-	0.02
Exhaust System Flow Rate (m <sup>3</sup> /sec)		20.53	19.99	20.06	-	-	-	20.19
Mass Loss (kg/m <sup>2</sup> )		5.75	5.62	5.63	-	-	-	5.67
Average Rate of Mass Loss (g/m <sup>2</sup> ·s)		84.02	82.19	83.20	-	-	-	83.14
Total Mass Pyrolyzed (%)		30.00	42.00	30.00	-	-	-	34.00
Time to 50kW/m² (sec)	t <sub>50</sub>	2.00	1.43	2.00	-	-	-	1.81
Ignitability Index (1/min)	l <sub>ig</sub>	3600	3600	3600	-	-	-	3600.00
Test Duration (sec)		49.92	50	50	-	-	-	49.97
Peak Rate of Heat Release(0-60s)		217.72	239.62	210.00	-	-	-	224.41
Peak Rate of Heat Release(0-180s)		217.72	239.62	215.90	-	-	-	224.41
Peak Rate of Heat Release(0-300s)		217.72	239.62	215.90	-	-	-	224.41
Average Rate of Heat Release(0-60s)		183.35	182.26	186.20	-	-	-	183.94
Average Rate of Heat Release(0-180s)		124.51	129.05	140.34	-	-	-	131.30
Average Rate of Heat Release(0-300s)		106.35	107.38	122.12	-	-	-	111.95
Total Heat Released (MJ/m <sup>2</sup> )		274.01	178.91	218.99	-	-	-	223.97
Average Effective Heat of Combustion (MJ/kg)	$\Delta h_{c,eff(avg)}$	13.34	8.97	13.66	-	-	-	11.99
Average specific Extinction Area (m <sup>2</sup> /kg)	$\Sigma_{f(avg)}$	9.87	34.47	24.17	-	-	-	22.84

Test Superviso

Darren Laker

Technical Leac

Jessica Ying


#### Version: IGNL-QF-050-Issue 03 Revision 00

Disclaimer These test results relate only to the behaviour of the test specimens of the material under the particular conditions of the test, and they are not intended to be the sole criterion for assessing the potential fire hazard of the material in use. The results of these fire tests may be used to directly assess fire hazard, but it should be recognized that a single test method will not provide a full assessment of fire hazard all fire conditions. The information contained in this document is provided for the sole use of the recipient and no reliance should be placed on the information by any other person. In the event that the information is disclosed or furnished to any other person, the Ignis Labs Pty Ltd accepts no liability for any loss or damage incurred by that person whatsoever as a result of using the information.

Copyright © All rights reserved. No part of the content of this document may be reproduced, published, transmitted or adapted in any form or by any means without the written permission of Ignis Labs Pty Ltd.




# **SPECIMEN 1 GRAPHS**

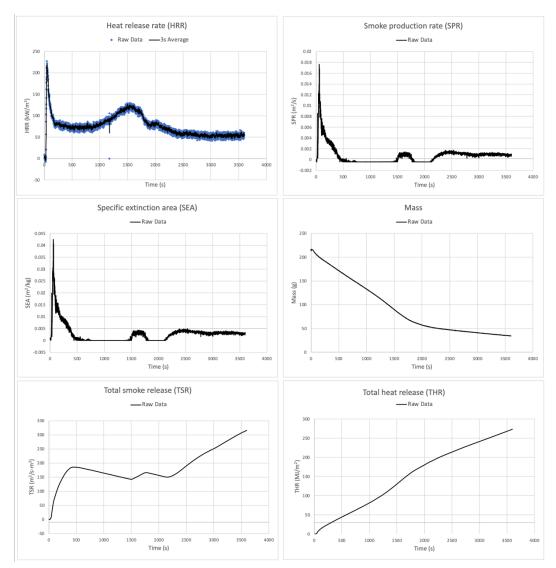



IGNL-7055-07-01C I01 R00



## **SPECIMEN 2 GRAPHS**

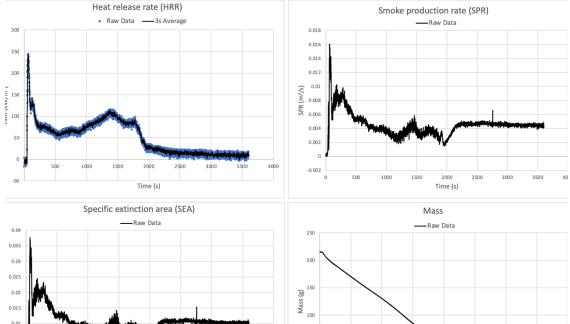

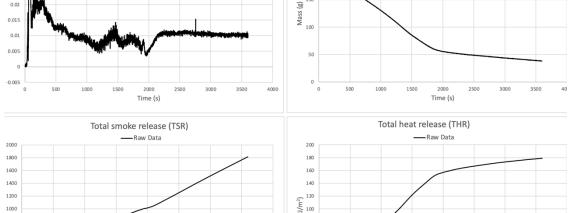

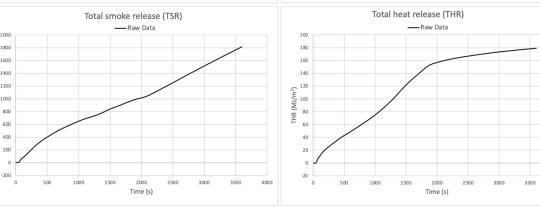



## IGNL-7056-07-01C I01 R00

40



## **SPECIMEN 3 GRAPHS**

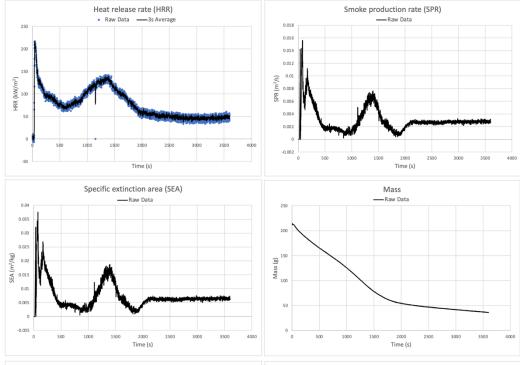

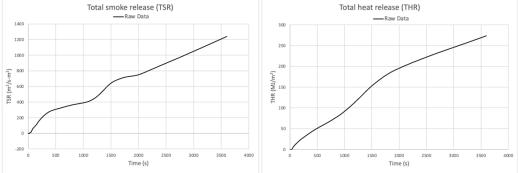

IGNL-7055-07-01C I01 R00

END OF TEST CERTIFICATE